

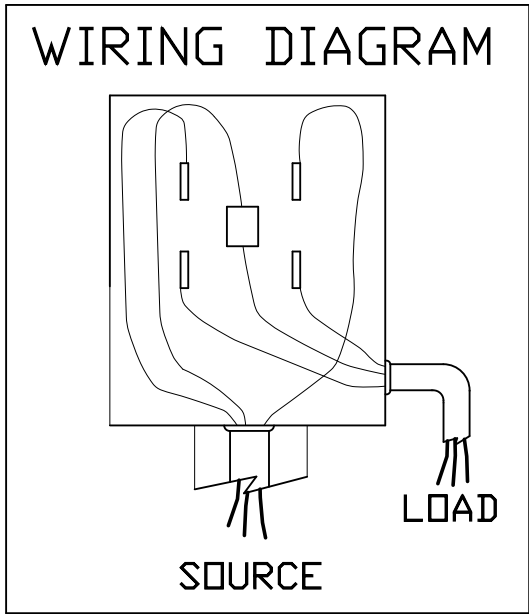
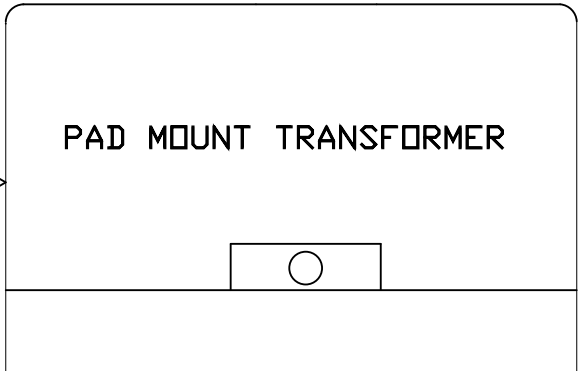


REAR VIEW

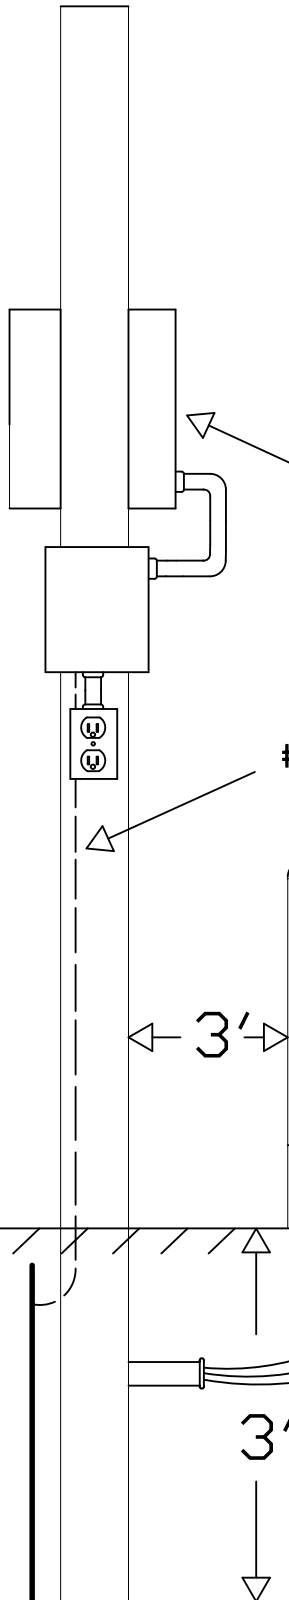

POLE:
10' TALL
4"X4"
TREATED

FRONT VIEW

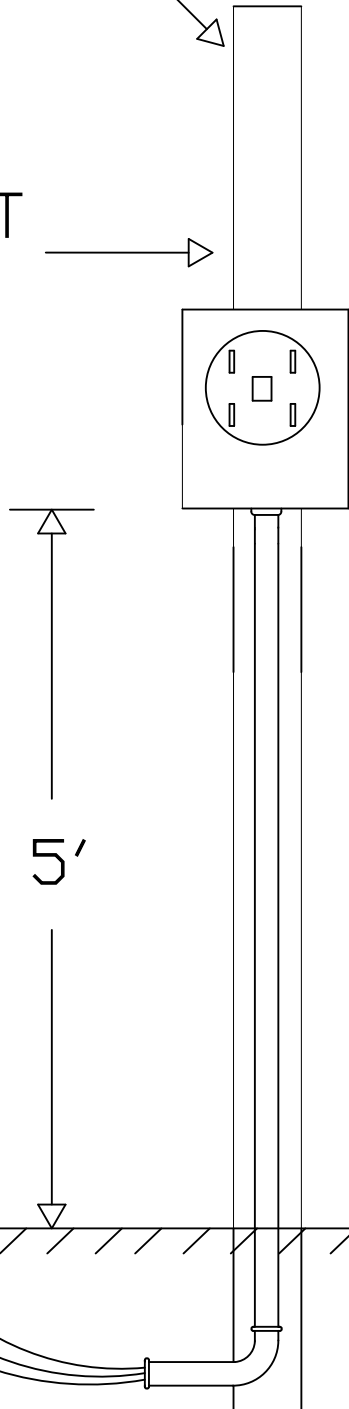

CONDUCTORS
MUST BE:
- 600V URD
- 10' LONG

TEMPORARY URD METER POLE	
TALLAHATCHIE VALLEY ELECTRIC POWER ASSOCIATION	
DATE: 5/7/2002	DRAWN BY: KD
MP-2	